




TYPICAL PILE TOP DETAIL

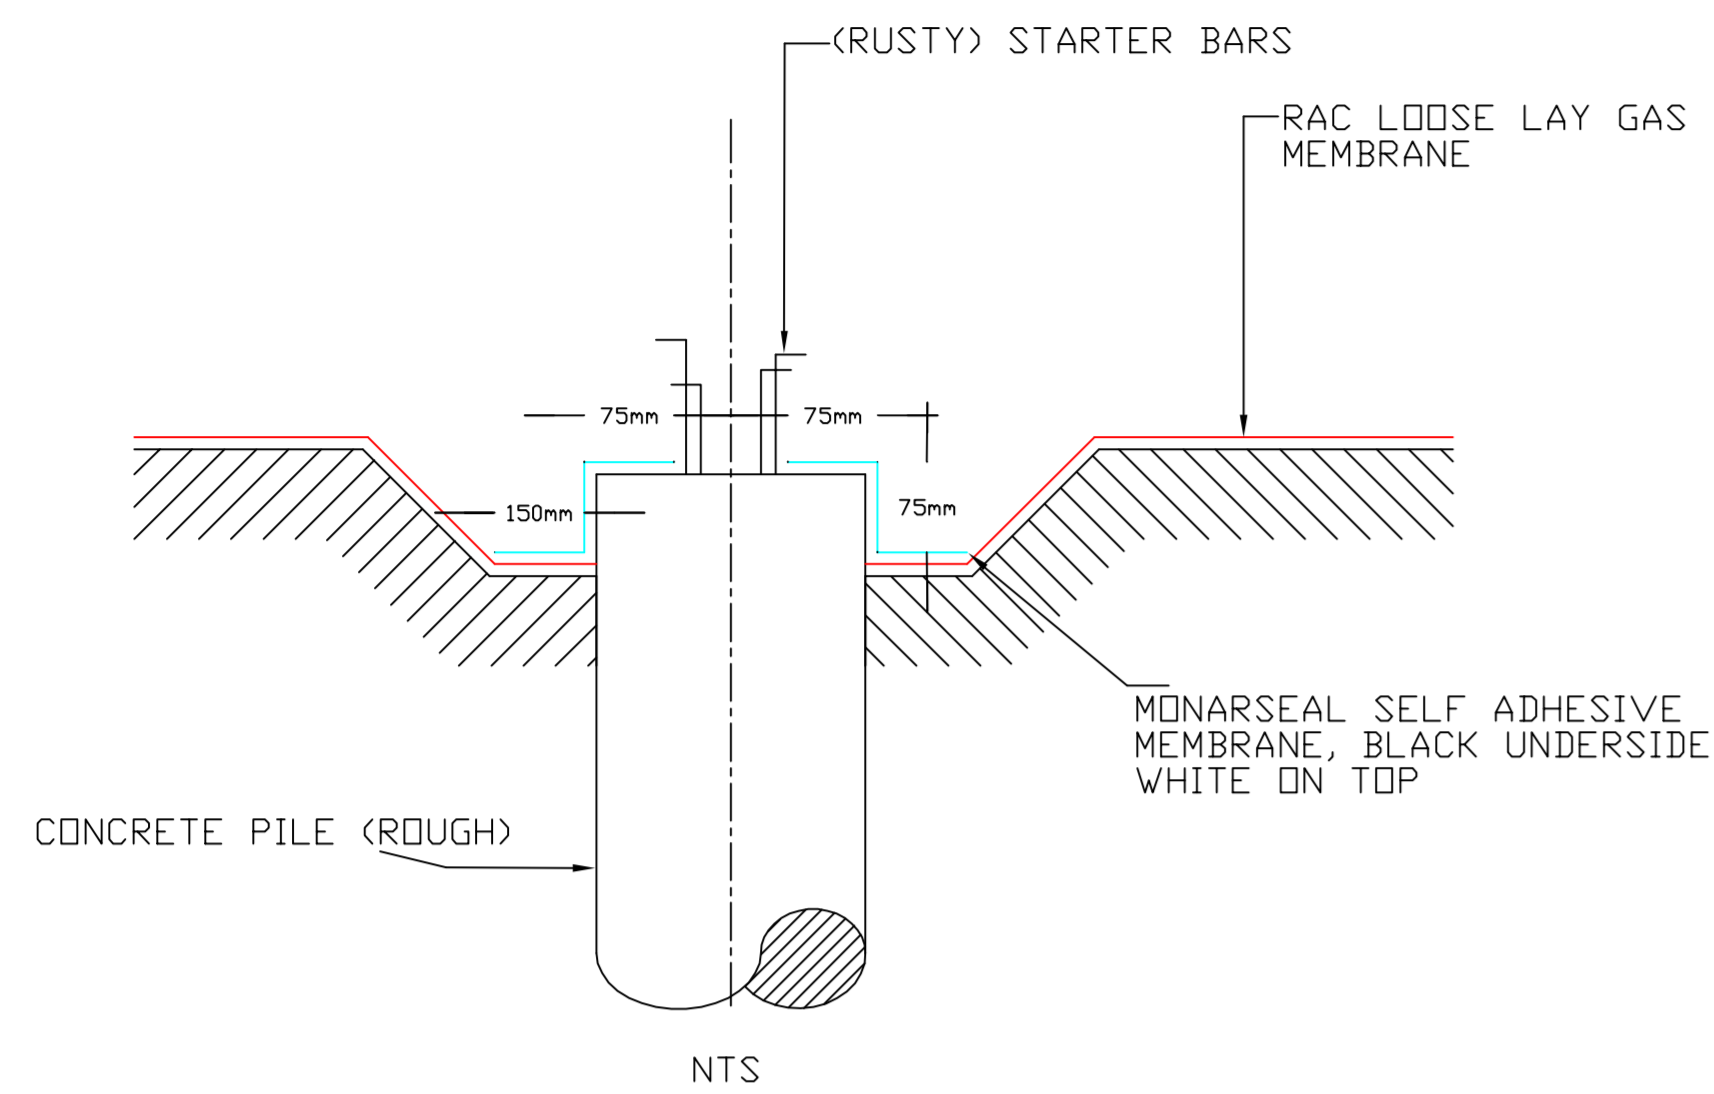

OVERLAP DETAIL


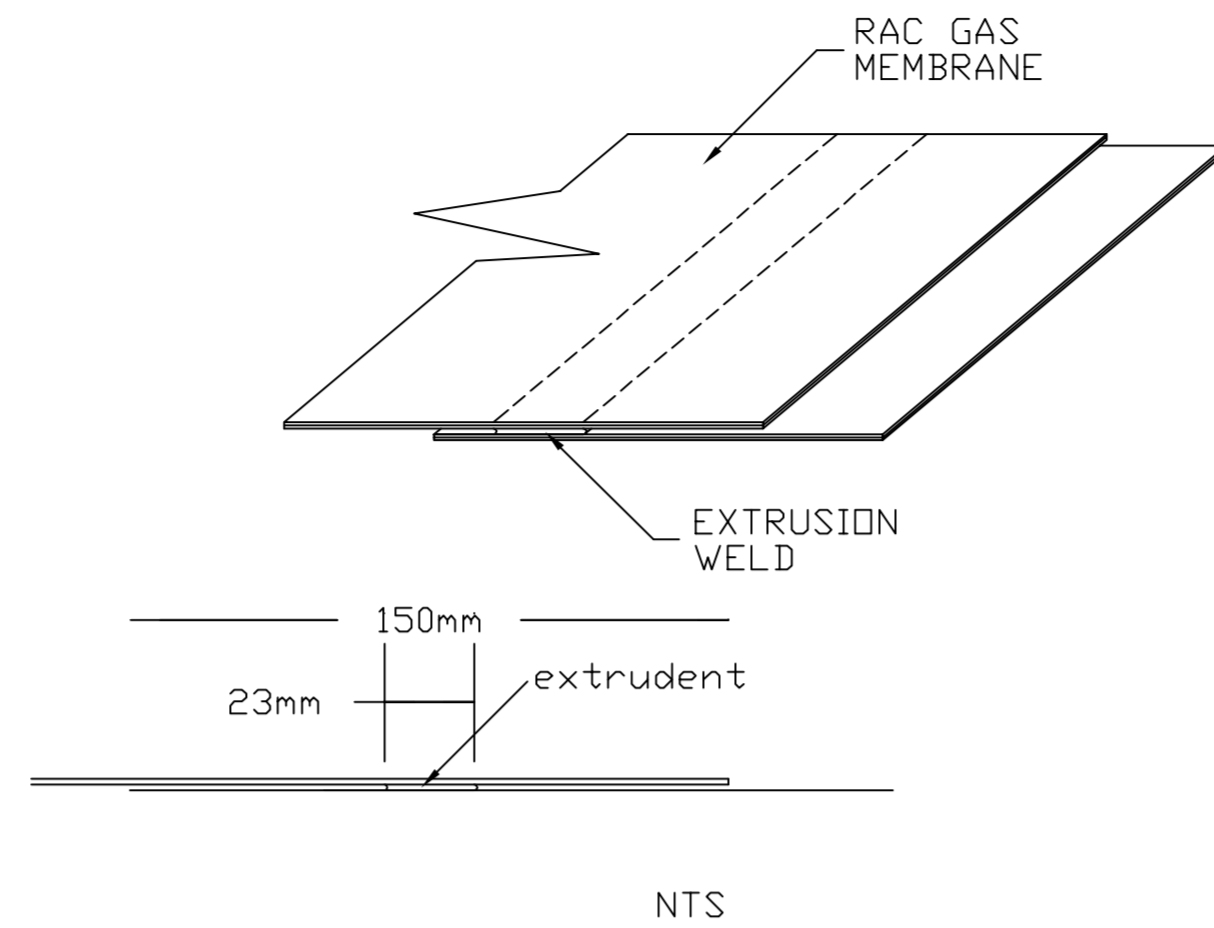


METHOD FOR SEALING TO PILE TOPS/COLUMNS

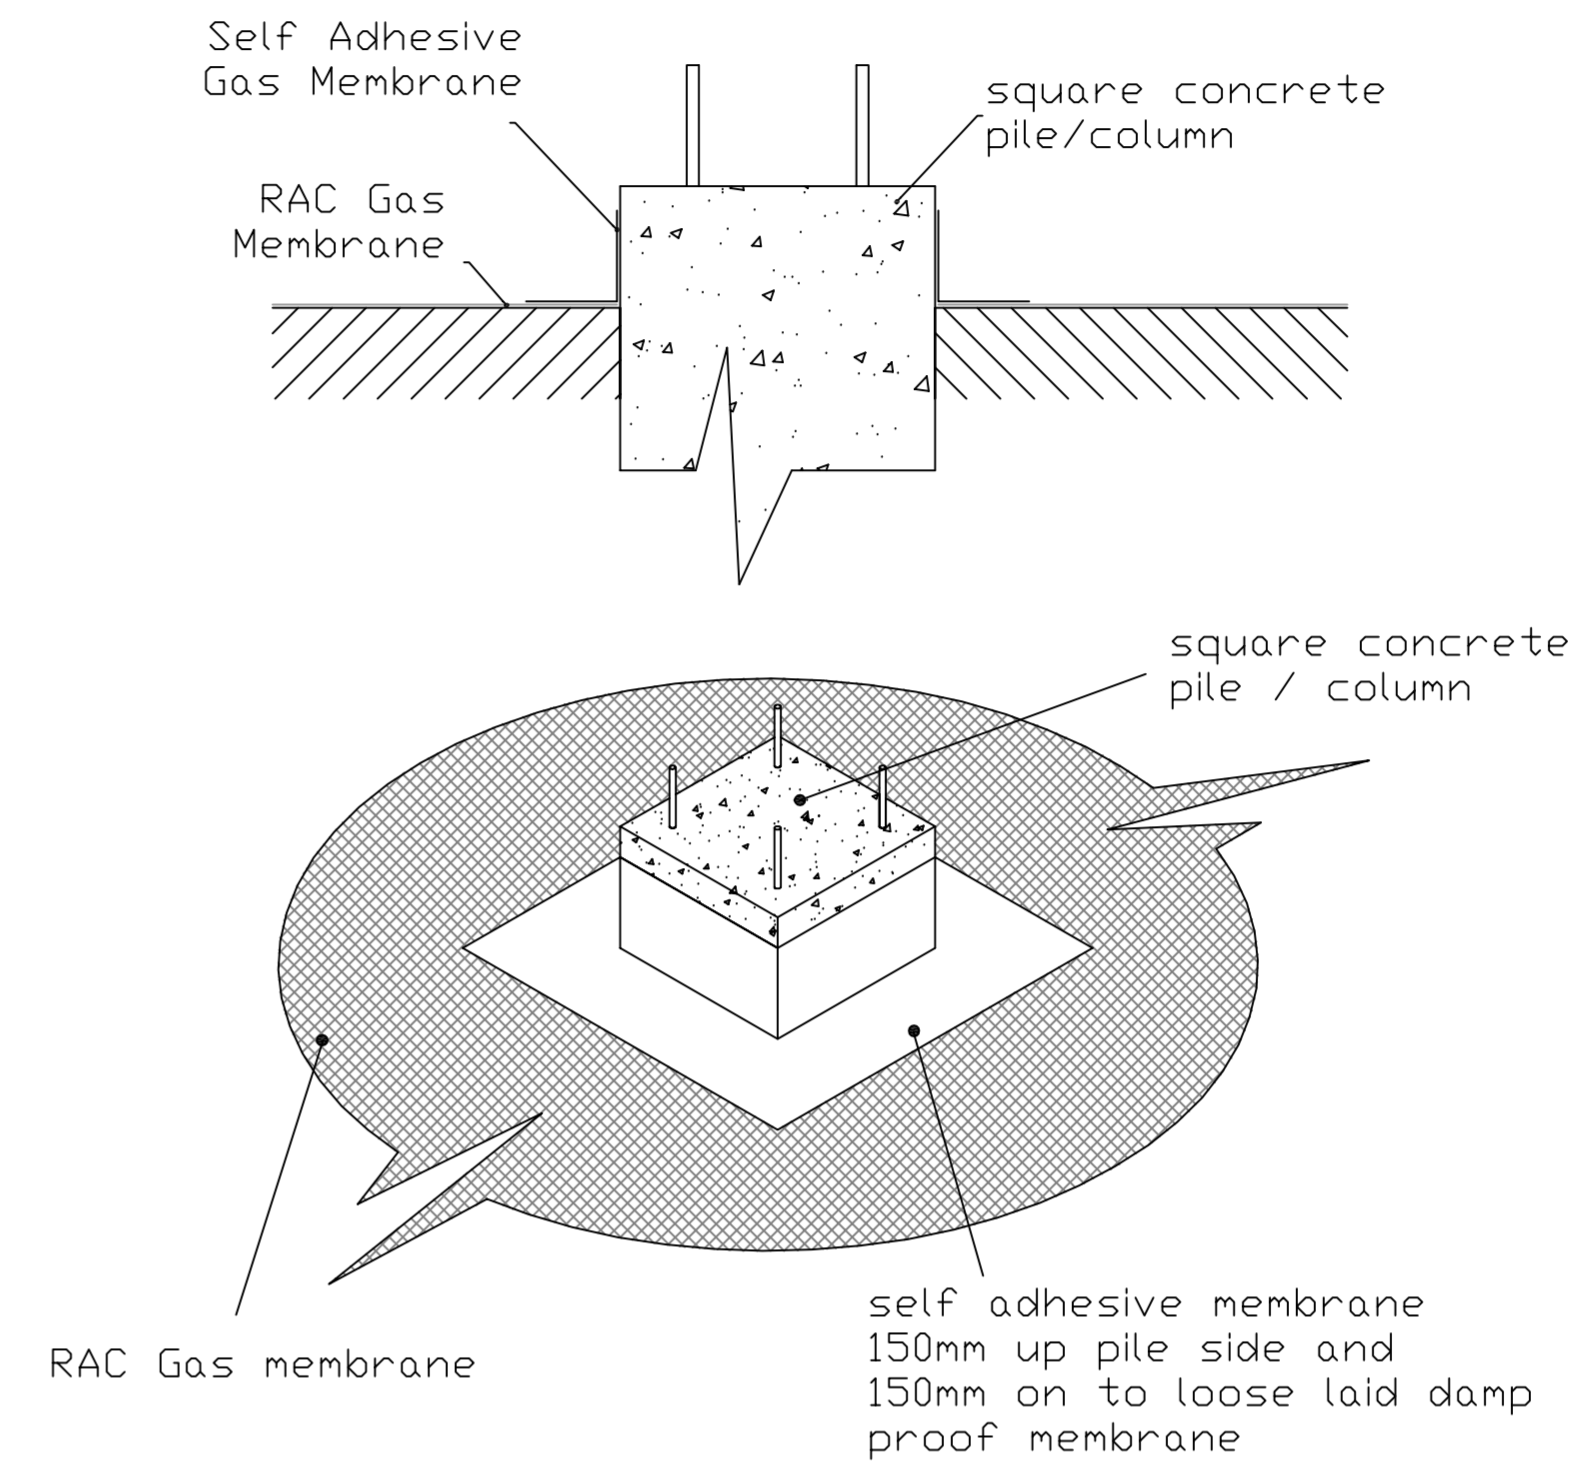


- GENERAL NOTES
1. ALL EXTERNAL AND INTERNAL COLUMNS TO BE SEALED IN ACCORDANCE WITH TYPICAL COLUMN DETAIL.
 2. MANHOLE AND GULLYS TO BE SEALED IN ACCORDANCE WITH TYPICAL MANHOLE/GULLY DETAIL.
 3. PIPE PENETRATIONS TO BE SEALED IN ACCORDANCE WITH TYPICAL PIPE PENETRATION DETAIL.
 4. MINIMUM 70mm DISTANCE BETWEEN PIPE PENETRATIONS TO ALLOW FOR SEAL TO BE MADE
 5. ALL IRREGULAR OR ANGLED PIPES TO BE SEALED USING MONARSEAL SELF ADHESIVE GAS MEMBRANE ALLOWING 150mm LAP INTO MEMBRANE AND PIPE
 6. RAC GAS MEMBRANE TO BE LAPPED AND EXTRUSION WELDED WITH MINIMUM 100mm OVERLAP


STANDARD TOP HAT TO SERVICE PIPE DETAIL

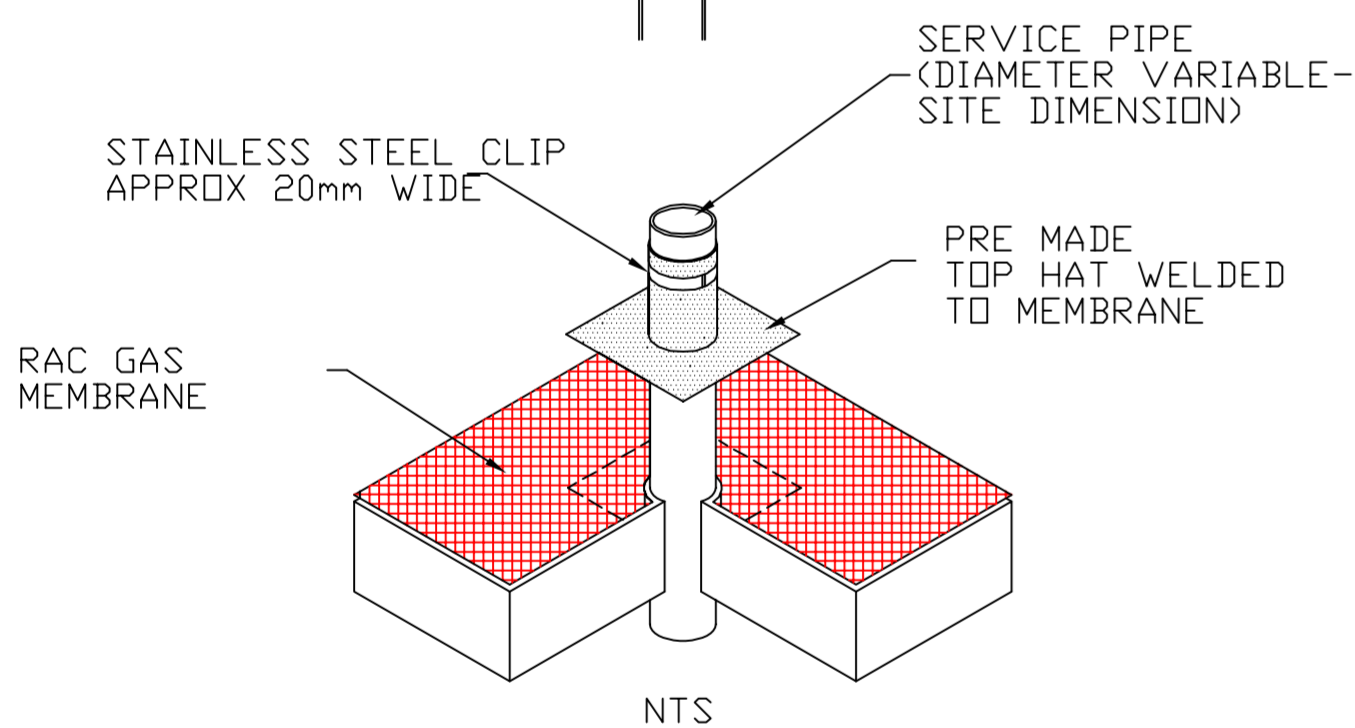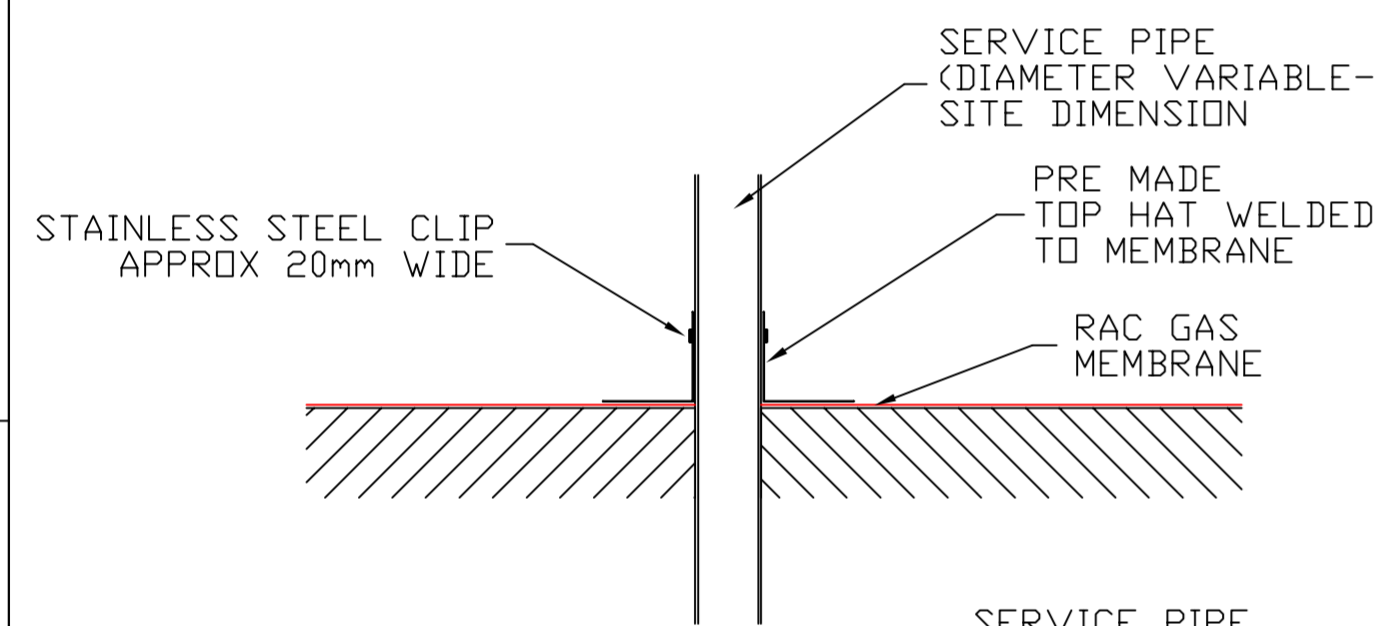


TYPICAL STARTER BAR DETAIL

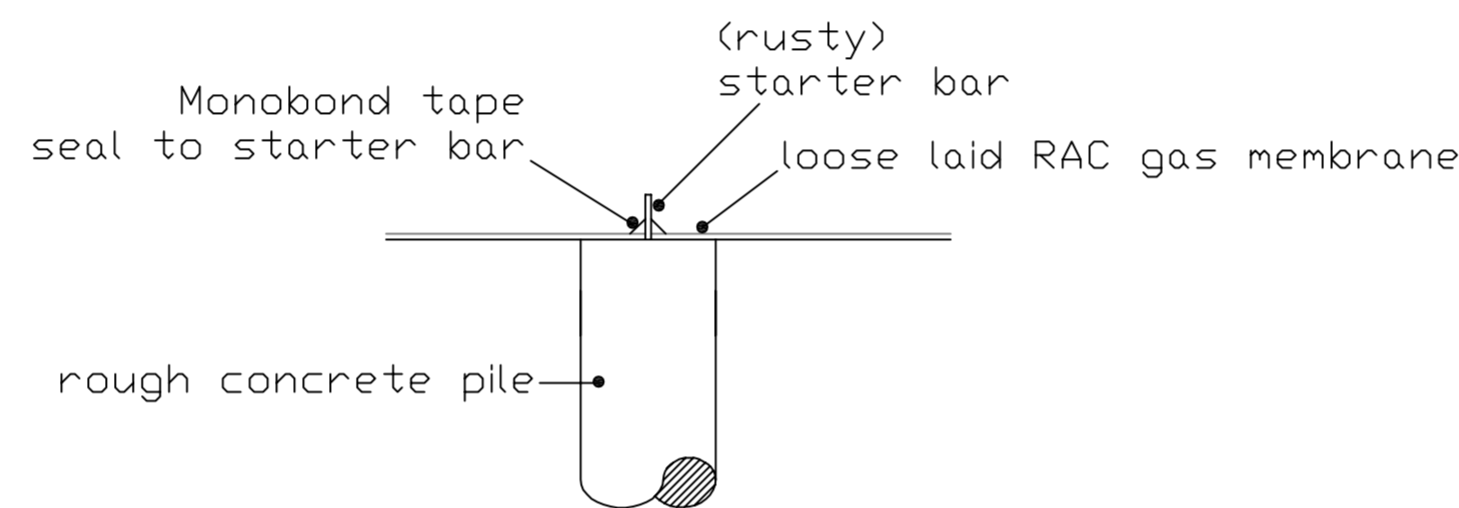


TYPICAL PILE STARTER BAR DETAIL

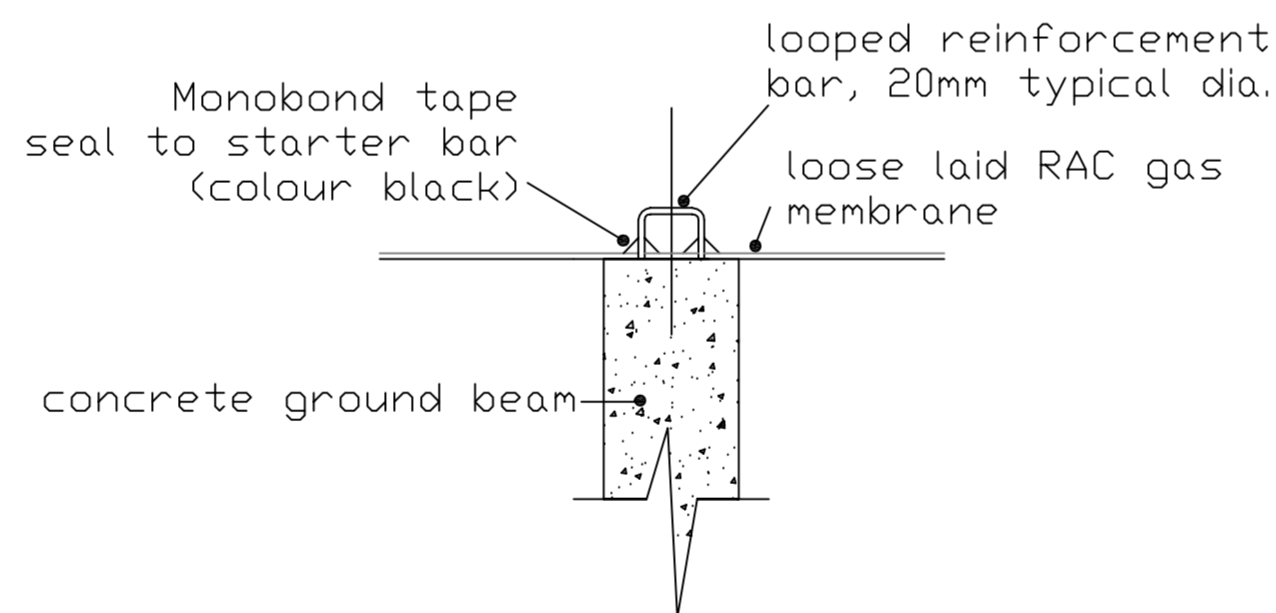


TYPICAL STANCHION DETAIL

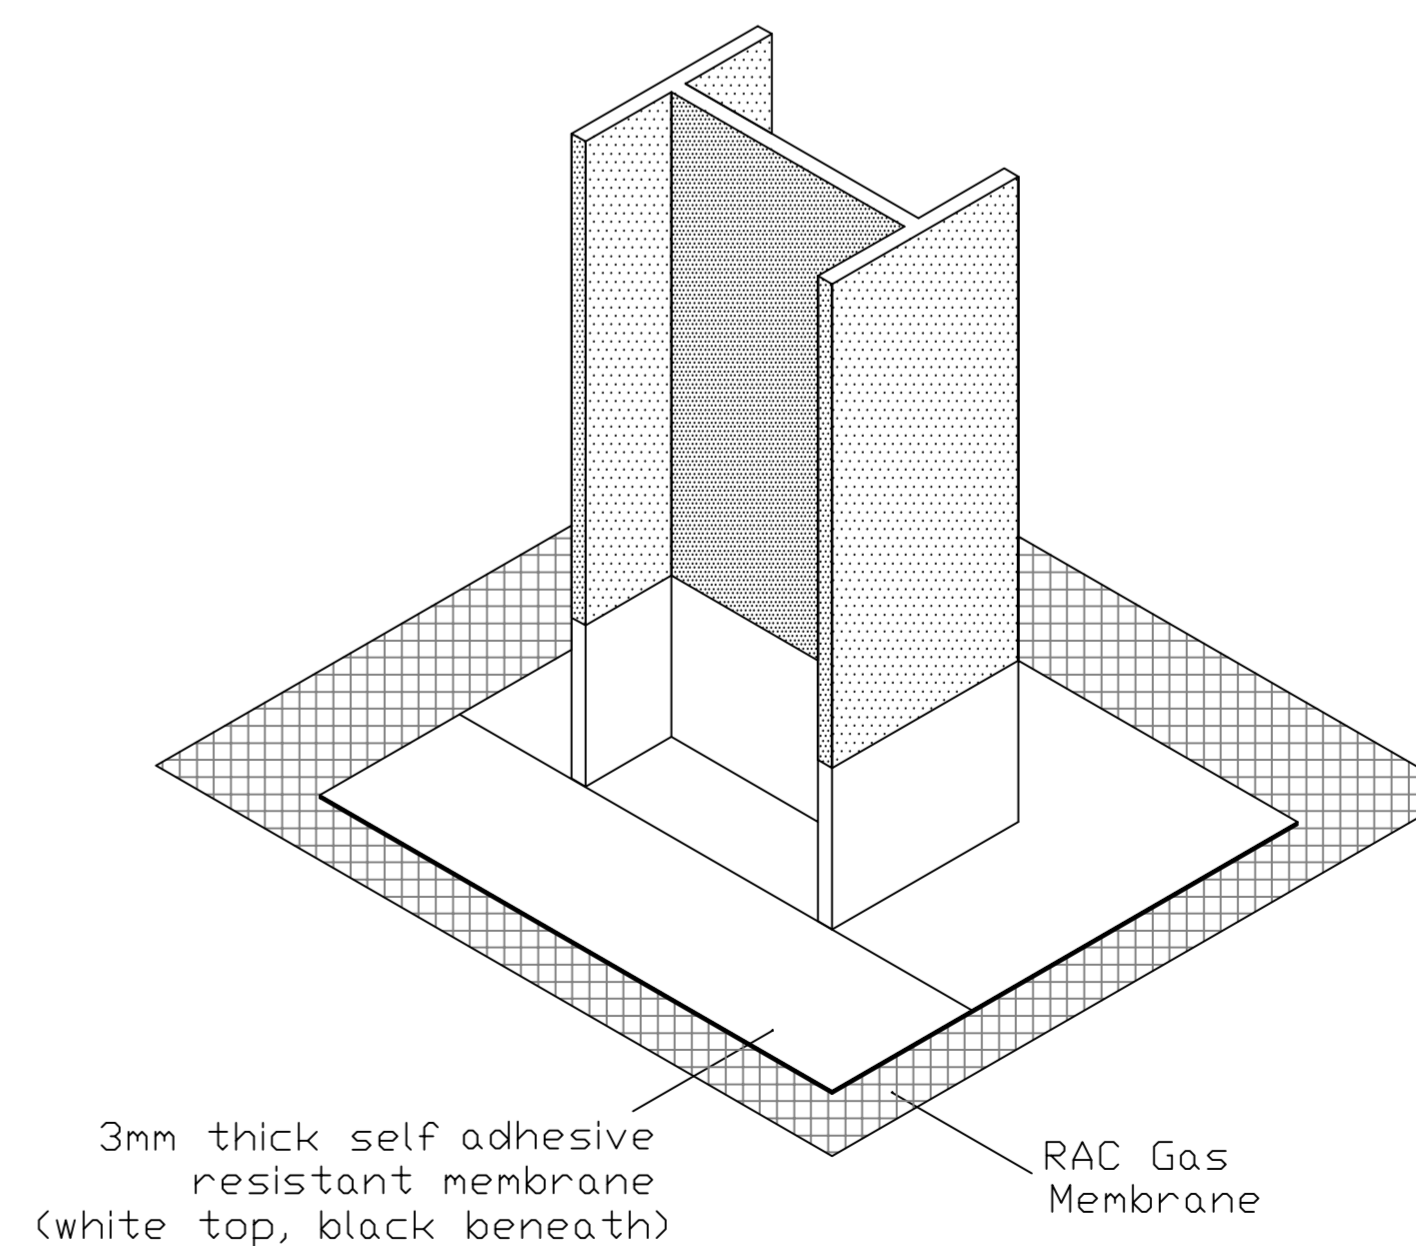

TYPICAL MANHOLE AND GULLY SEALING DETAIL

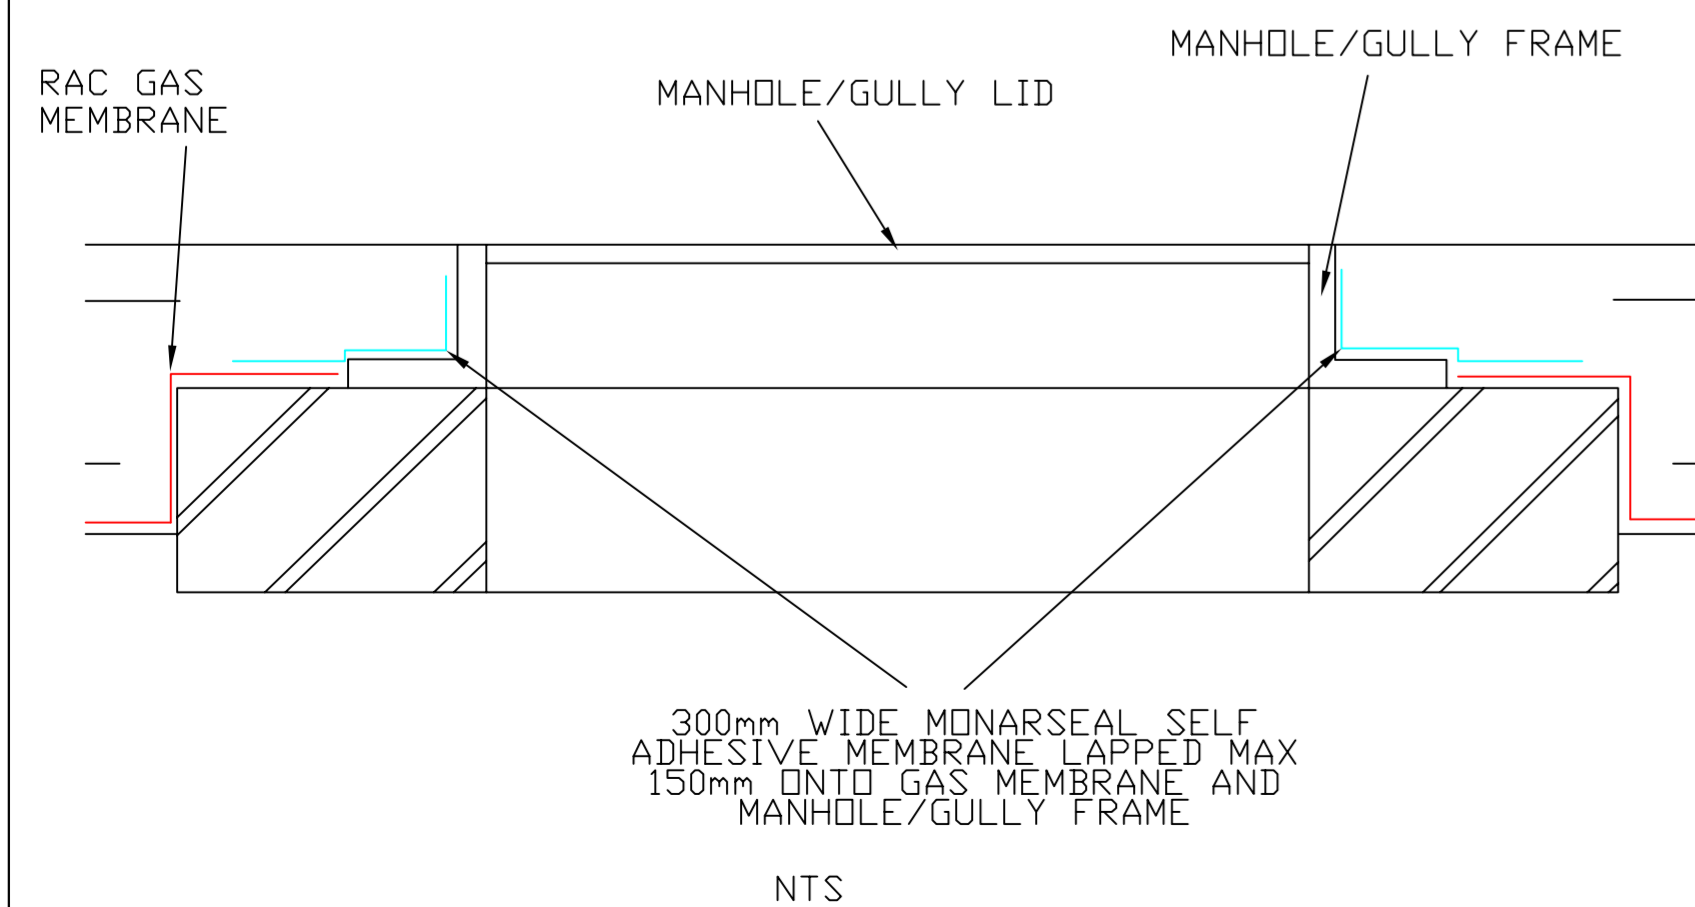

MEMBRANE DETAIL AT DOORWAY

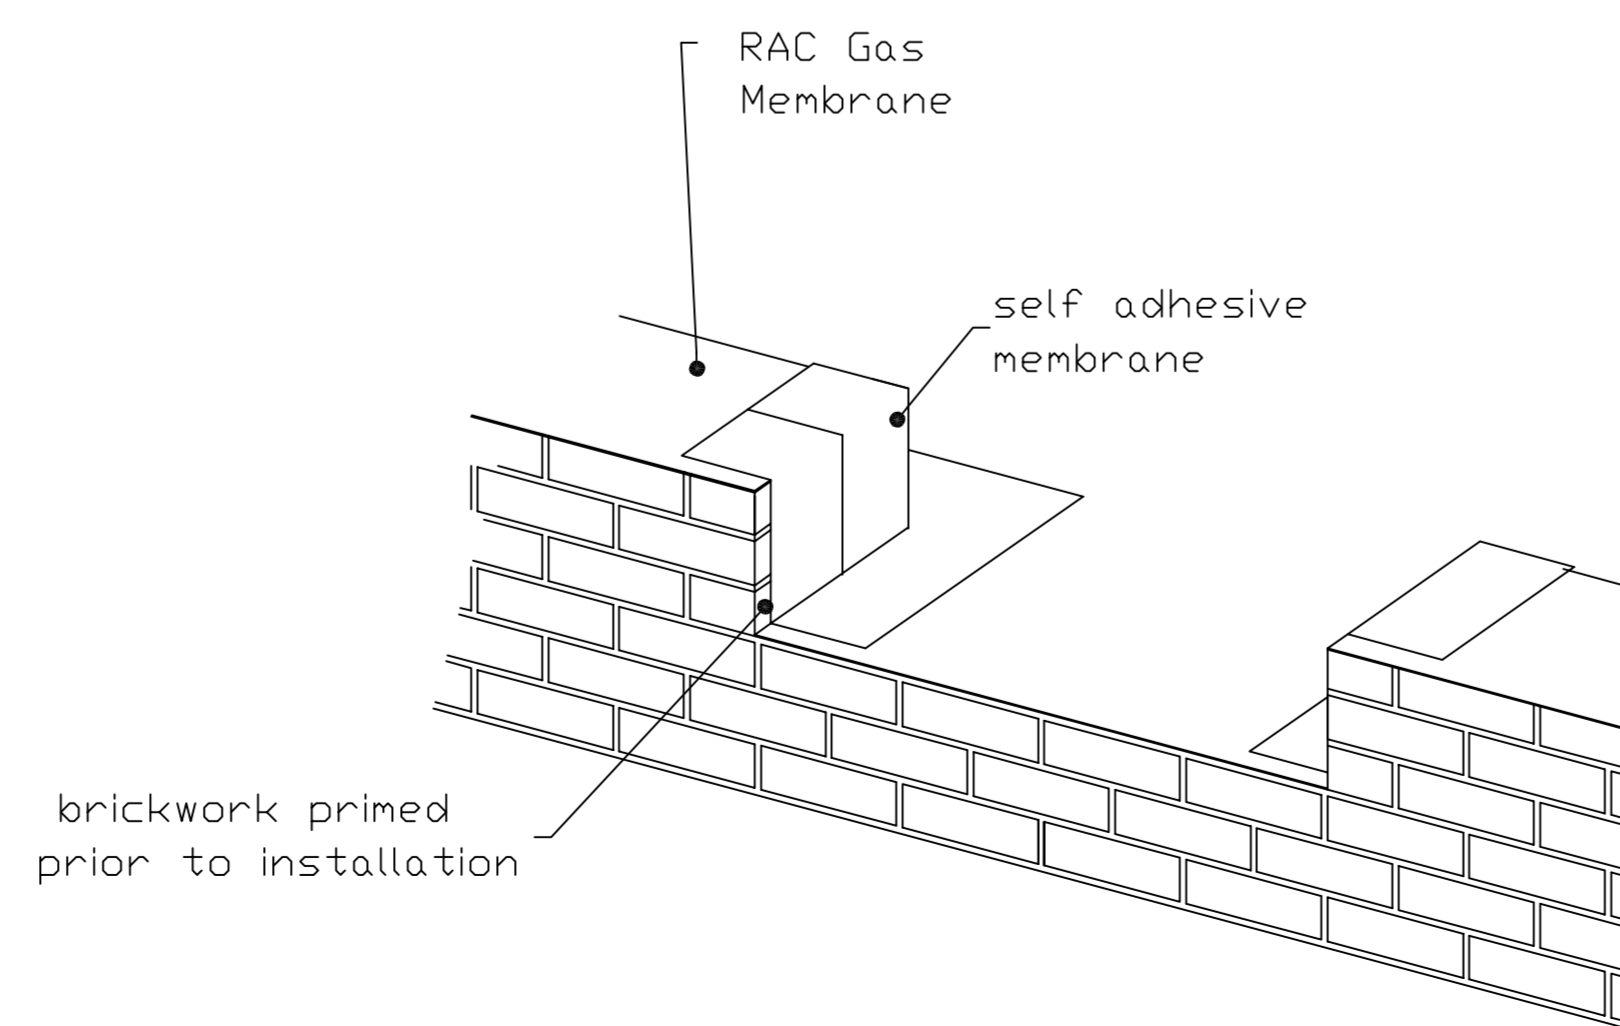


LEGEND TO SYMBOLS

Rev	Drawn	Date	Apprv.	Date	Modification Details
x	x	x	x	x	x

AMENDMENTS

Title	RAC GAS MEMBRANE STANDARD DETAILS				
Project					
Client					

Date		Drawn By		Apprv. By	
APR 2010		NC			
Sheet Size	Scale	Project No			
A1	AS SHOWN				
Drawing No			Rev		
1000/13			1		

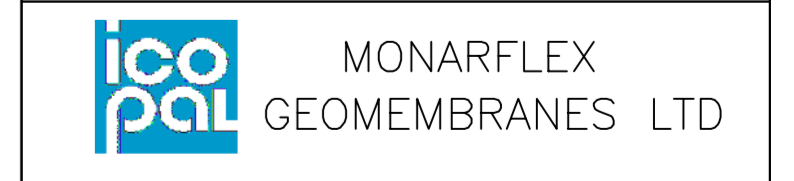

\$DATES \$TIMES \$FILES\$